


Příloha č.5 ke smlouvě na dodávku a odběr tepelné energie
 Diagram otopných křivek, ústřední topení - výstup

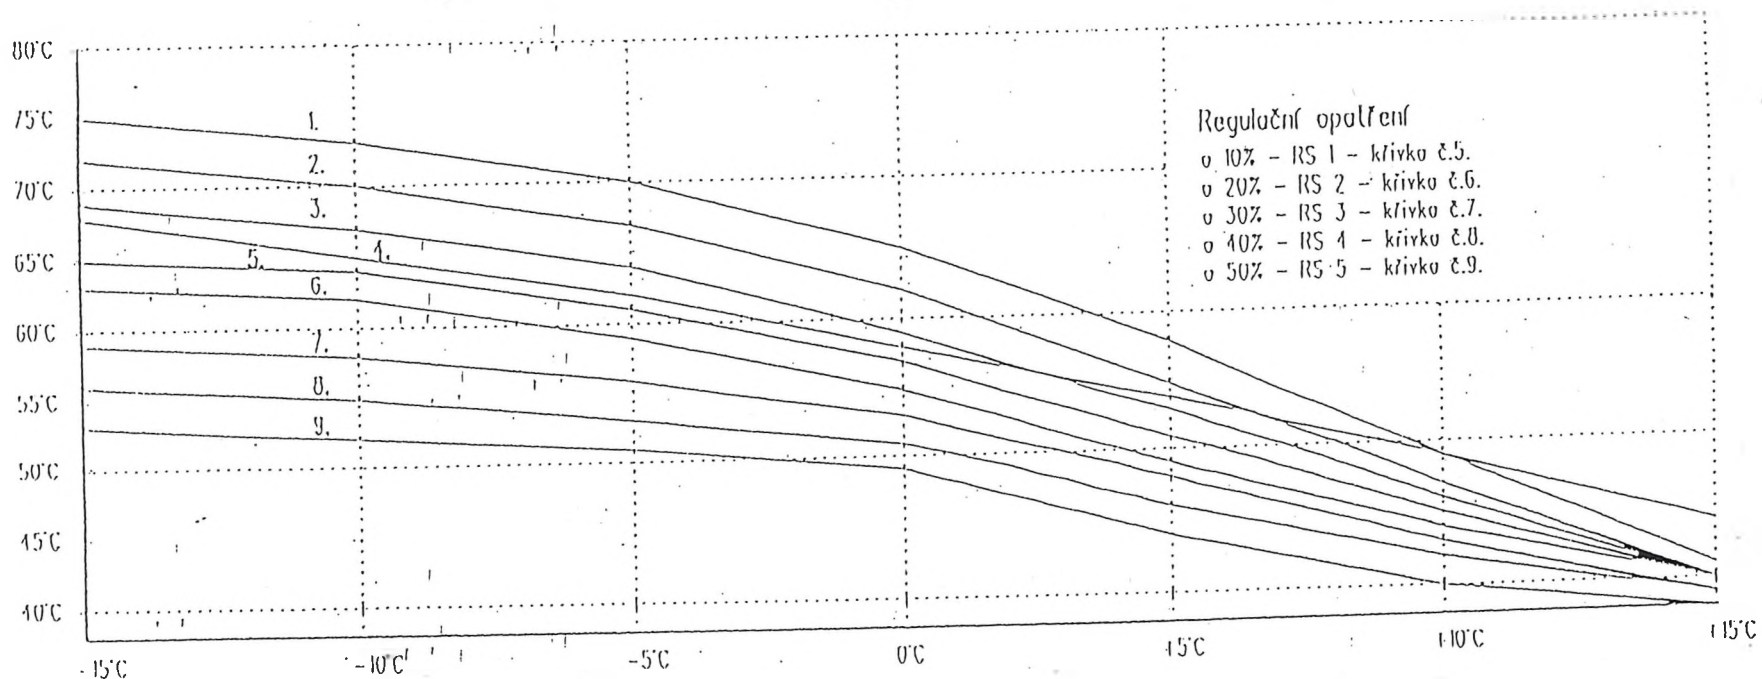

| | -15 | -14 | -13 | -12 | -11 | -10 | -9 | -8 | -7 | -6 | -5 | -4 | -3 | -2 | -1 | 0 | +1 | +2 | +3 | +4 | +5 | +6 | +7 | +8 | +9 | +10 | +11 | +12 | +13 | +14 | +15 | |
|----|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|
| 1. | 75.0 | 74.6 | 74.2 | 73.8 | 73.4 | 73.0 | 72.4 | 71.8 | 71.2 | 70.6 | 70.0 | 69.0 | 68.0 | 67.0 | 66.0 | 65.0 | 63.6 | 62.2 | 60.8 | 59.4 | 58.0 | 56.2 | 54.4 | 52.6 | 50.8 | 49.0 | 47.4 | 45.8 | 44.2 | 42.6 | 41.0 | |
| 2. | 72.0 | 71.6 | 71.2 | 70.8 | 70.4 | 70.0 | 69.4 | 68.8 | 68.2 | 67.6 | 67.0 | 66.0 | 65.0 | 64.0 | 63.0 | 62.0 | 60.6 | 59.2 | 57.8 | 56.4 | 55.0 | 53.4 | 51.8 | 50.2 | 48.6 | 47.0 | 45.6 | 44.2 | 42.8 | 41.4 | 40.0 | |
| 3. | 69.0 | 68.6 | 68.2 | 67.8 | 67.4 | 67.0 | 66.4 | 65.8 | 65.2 | 64.6 | 64.0 | 63.0 | 62.0 | 61.0 | 60.0 | 59.0 | 57.8 | 56.6 | 55.4 | 54.2 | 53.0 | 51.6 | 50.2 | 48.6 | 47.0 | 45.6 | 44.2 | 42.8 | 41.4 | 40.0 | | |
| 4. | 68.0 | 67.4 | 66.8 | 66.2 | 65.6 | 65.0 | 64.4 | 63.8 | 63.2 | 62.6 | 62.0 | 61.2 | 60.4 | 59.6 | 58.8 | 58.0 | 57.2 | 56.4 | 55.6 | 54.8 | 54.0 | 53.0 | 52.0 | 51.0 | 50.0 | 49.0 | 48.0 | 47.0 | 46.0 | 45.0 | 44.0 | 43.0 |
| 5. | 65.0 | 64.8 | 64.6 | 64.4 | 64.2 | 64.0 | 63.4 | 62.8 | 62.2 | 61.6 | 61.0 | 60.2 | 59.4 | 58.6 | 57.8 | 57.0 | 55.8 | 54.6 | 53.4 | 52.2 | 51.0 | 49.8 | 48.6 | 47.4 | 46.2 | 45.0 | 44.0 | 43.0 | 42.0 | 41.0 | 40.0 | |
| 6. | 63.0 | 62.8 | 62.6 | 62.4 | 62.2 | 62.0 | 61.4 | 60.8 | 60.2 | 59.6 | 59.0 | 58.2 | 57.4 | 56.6 | 55.8 | 55.0 | 53.8 | 52.6 | 51.4 | 50.2 | 49.0 | 48.0 | 47.0 | 46.0 | 45.0 | 44.0 | 43.2 | 42.4 | 41.6 | 40.8 | 40.0 | |
| 7. | 59.0 | 58.8 | 58.6 | 58.4 | 58.2 | 58.0 | 57.6 | 57.2 | 56.8 | 56.4 | 56.0 | 55.4 | 54.8 | 54.2 | 53.6 | 53.0 | 52.0 | 51.0 | 50.0 | 49.0 | 48.0 | 47.0 | 46.0 | 45.0 | 44.0 | 43.0 | 42.2 | 41.4 | 40.6 | 39.8 | 39.0 | |
| 8. | 56.0 | 55.8 | 55.6 | 55.4 | 55.2 | 55.0 | 54.6 | 54.2 | 53.8 | 53.4 | 53.0 | 52.6 | 52.2 | 51.8 | 51.4 | 51.0 | 50.0 | 49.0 | 48.0 | 47.0 | 46.0 | 45.2 | 44.4 | 43.6 | 42.8 | 42.0 | 41.4 | 40.8 | 40.2 | 39.6 | 39.0 | |
| 9. | 53.0 | 52.8 | 52.6 | 52.4 | 52.2 | 52.0 | 51.8 | 51.6 | 51.4 | 51.2 | 51.0 | 50.6 | 50.2 | 49.8 | 49.4 | 49.0 | 48.0 | 47.0 | 46.0 | 45.0 | 44.0 | 43.2 | 42.4 | 41.6 | 40.8 | 40.0 | 39.6 | 39.2 | 38.8 | 38.4 | 38.0 | |


V Ostravě

15-02-2002

.....
 dodavatel

.....
 odběratel

Příloha č.6 ke smlouvě na dodávku a odběr teplotné energie
 Diagram otopných křivek, topná voda - výstup

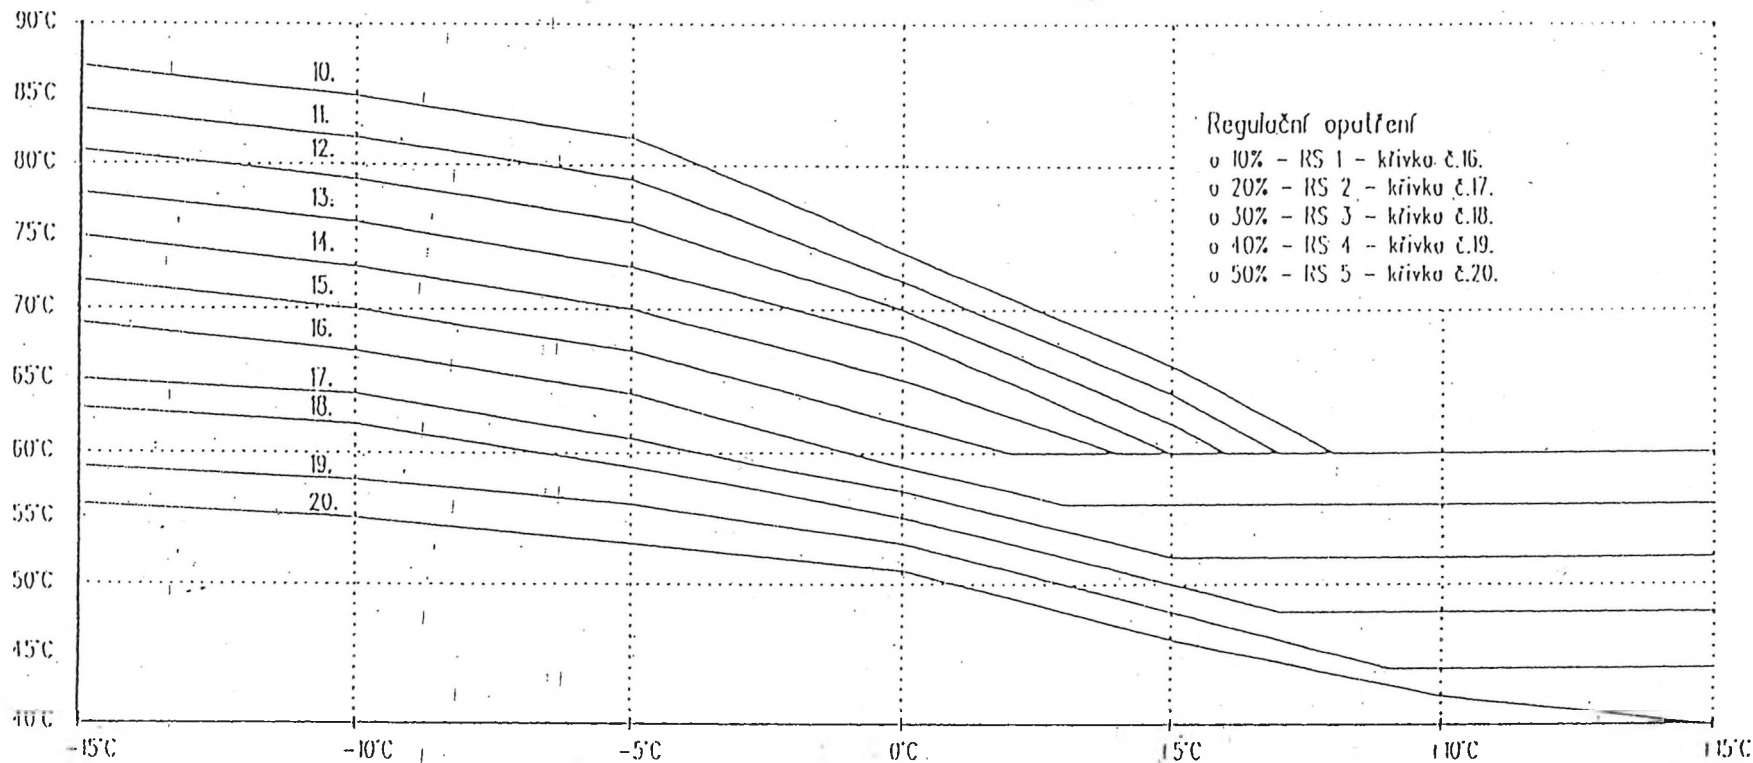

| | -15 | -14 | -13 | -12 | -11 | -10 | -9 | -8 | -7 | -6 | -5 | -4 | -3 | -2 | -1 | 0 | +1 | +2 | +3 | +4 | +5 | +6 | +7 | +8 | +9 | +10 | +11 | +12 | +13 | +14 | +15 | |
|-----|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|
| 10. | 87.0 | 86.6 | 86.2 | 85.8 | 85.4 | 85.0 | 84.4 | 83.8 | 83.2 | 82.6 | 82.0 | 80.4 | 78.8 | 77.2 | 75.6 | 74.0 | 72.4 | 70.8 | 69.2 | 67.6 | 66.0 | 64.0 | 62.0 | 60.0 | 60.0 | 60.0 | 60.0 | 60.0 | 60.0 | 60.0 | 60.0 | 60.0 |
| 11. | 84.0 | 83.6 | 83.2 | 82.8 | 82.4 | 82.0 | 81.4 | 80.8 | 80.2 | 79.6 | 79.0 | 77.6 | 76.2 | 74.8 | 73.4 | 72.0 | 70.4 | 68.8 | 67.2 | 65.6 | 64.0 | 62.0 | 60.0 | 60.0 | 60.0 | 60.0 | 60.0 | 60.0 | 60.0 | 60.0 | 60.0 | 60.0 |
| 12. | 81.0 | 80.6 | 80.2 | 79.8 | 79.4 | 79.0 | 78.4 | 77.8 | 77.2 | 76.6 | 76.0 | 74.8 | 73.6 | 72.4 | 71.2 | 70.0 | 68.4 | 66.8 | 65.2 | 63.6 | 62.0 | 60.0 | 60.0 | 60.0 | 60.0 | 60.0 | 60.0 | 60.0 | 60.0 | 60.0 | 60.0 | 60.0 |
| 13. | 78.0 | 77.6 | 77.2 | 76.8 | 76.4 | 76.0 | 75.4 | 74.8 | 74.2 | 73.6 | 73.0 | 72.0 | 71.0 | 70.0 | 69.0 | 68.0 | 66.4 | 64.8 | 63.2 | 61.6 | 60.0 | 60.0 | 60.0 | 60.0 | 60.0 | 60.0 | 60.0 | 60.0 | 60.0 | 60.0 | 60.0 | 60.0 |
| 14. | 75.0 | 74.6 | 74.2 | 73.8 | 73.4 | 73.0 | 72.4 | 71.8 | 71.2 | 70.6 | 70.0 | 69.0 | 68.0 | 67.0 | 66.0 | 65.0 | 64.0 | 63.0 | 62.0 | 61.0 | 60.0 | 60.0 | 60.0 | 60.0 | 60.0 | 60.0 | 60.0 | 60.0 | 60.0 | 60.0 | 60.0 | 60.0 |
| 15. | 72.0 | 71.6 | 71.2 | 70.8 | 70.4 | 70.0 | 69.4 | 68.8 | 68.2 | 67.6 | 67.0 | 66.0 | 65.0 | 64.0 | 63.0 | 62.0 | 61.0 | 60.0 | 60.0 | 60.0 | 60.0 | 60.0 | 60.0 | 60.0 | 60.0 | 60.0 | 60.0 | 60.0 | 60.0 | 60.0 | 60.0 | 60.0 |
| 16. | 69.0 | 68.6 | 68.2 | 67.8 | 67.4 | 67.0 | 66.4 | 65.8 | 65.2 | 64.6 | 64.0 | 63.0 | 62.0 | 61.0 | 60.0 | 59.0 | 58.0 | 57.0 | 56.0 | 56.0 | 56.0 | 56.0 | 56.0 | 56.0 | 56.0 | 56.0 | 56.0 | 56.0 | 56.0 | 56.0 | 56.0 | 56.0 |
| 17. | 65.0 | 64.6 | 64.2 | 63.8 | 63.4 | 63.0 | 62.4 | 61.8 | 61.2 | 60.6 | 60.0 | 59.0 | 58.0 | 57.0 | 56.0 | 55.0 | 54.0 | 53.0 | 52.0 | 52.0 | 52.0 | 52.0 | 52.0 | 52.0 | 52.0 | 52.0 | 52.0 | 52.0 | 52.0 | 52.0 | 52.0 | 52.0 |
| 18. | 63.0 | 62.6 | 62.2 | 61.8 | 61.4 | 61.0 | 60.4 | 59.8 | 59.2 | 58.6 | 58.0 | 57.0 | 56.0 | 55.0 | 54.0 | 53.0 | 52.0 | 51.0 | 50.0 | 50.0 | 50.0 | 50.0 | 50.0 | 50.0 | 50.0 | 50.0 | 50.0 | 50.0 | 50.0 | 50.0 | 50.0 | 50.0 |
| 19. | 59.0 | 58.6 | 58.2 | 57.8 | 57.4 | 57.0 | 56.4 | 55.8 | 55.2 | 54.6 | 54.0 | 53.0 | 52.0 | 51.0 | 50.0 | 49.0 | 48.0 | 47.0 | 46.0 | 46.0 | 46.0 | 46.0 | 46.0 | 46.0 | 46.0 | 46.0 | 46.0 | 46.0 | 46.0 | 46.0 | 46.0 | 46.0 |
| 20. | 56.0 | 55.6 | 55.2 | 54.8 | 54.4 | 54.0 | 53.4 | 52.8 | 52.2 | 51.6 | 51.0 | 50.0 | 49.0 | 48.0 | 47.0 | 46.0 | 45.0 | 44.0 | 43.0 | 42.0 | 42.0 | 42.0 | 42.0 | 42.0 | 42.0 | 42.0 | 42.0 | 42.0 | 42.0 | 42.0 | 42.0 | 42.0 |

V Ostravě

dodavatel

15-02-2002

odběratel